



Horizontal Radiation Pattern

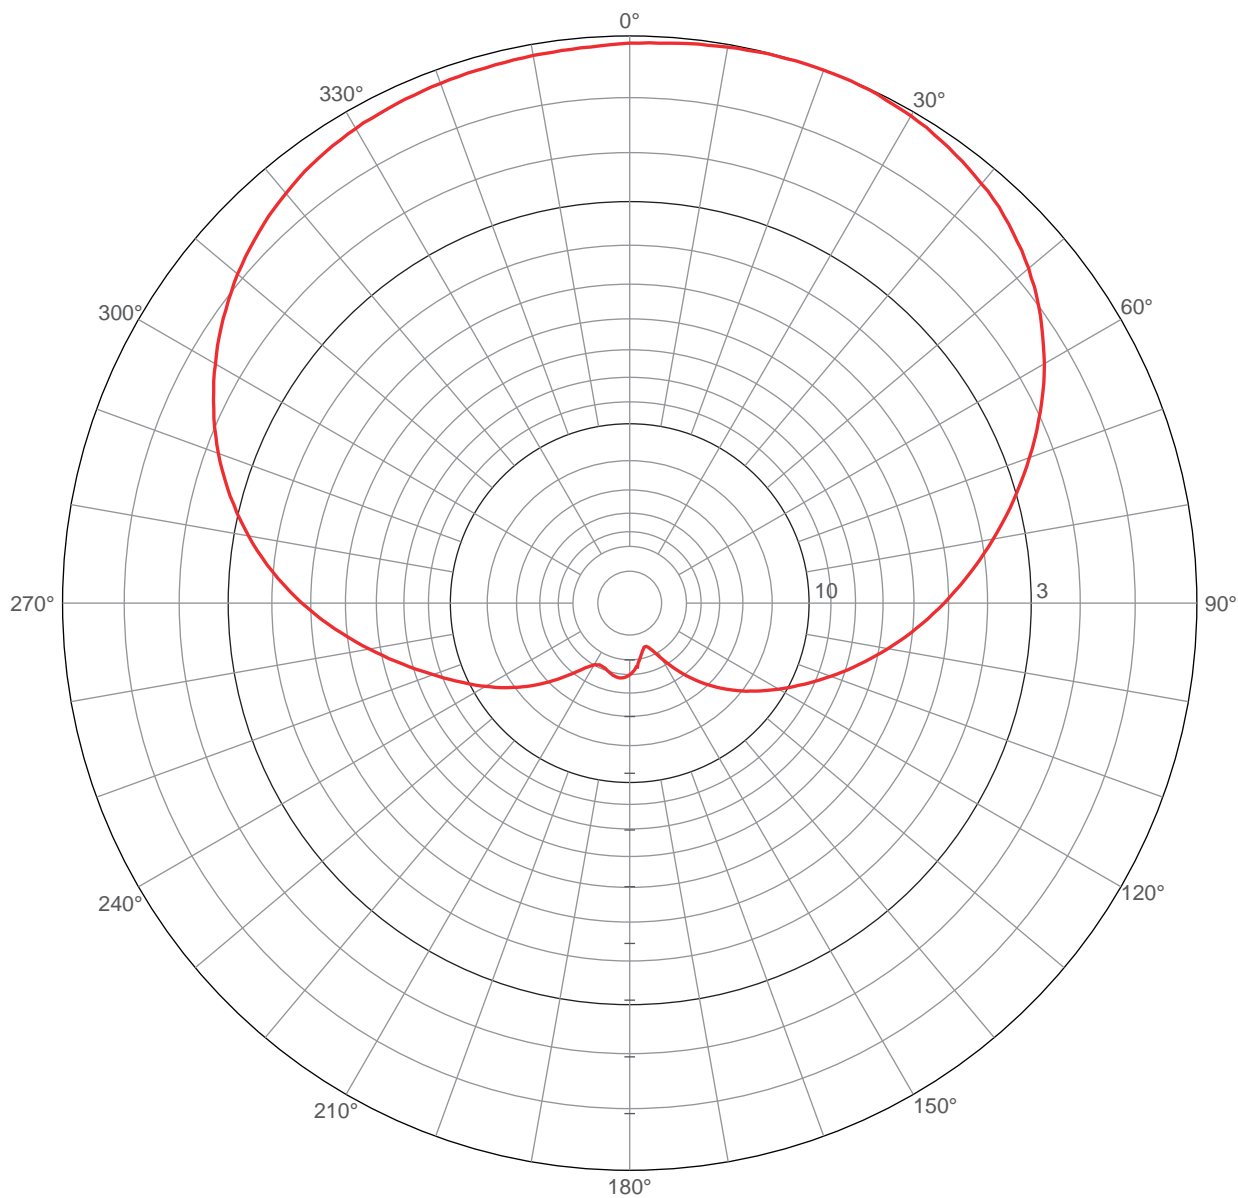

Subject to alternation


| | |
|-----------------------|---------|
| UHF Cardioid Panel | |
| Frequency | 650 MHz |
| Gain | 10 dBd |
| Half Power Beam Width | 152° |

Vertical Radiation Pattern

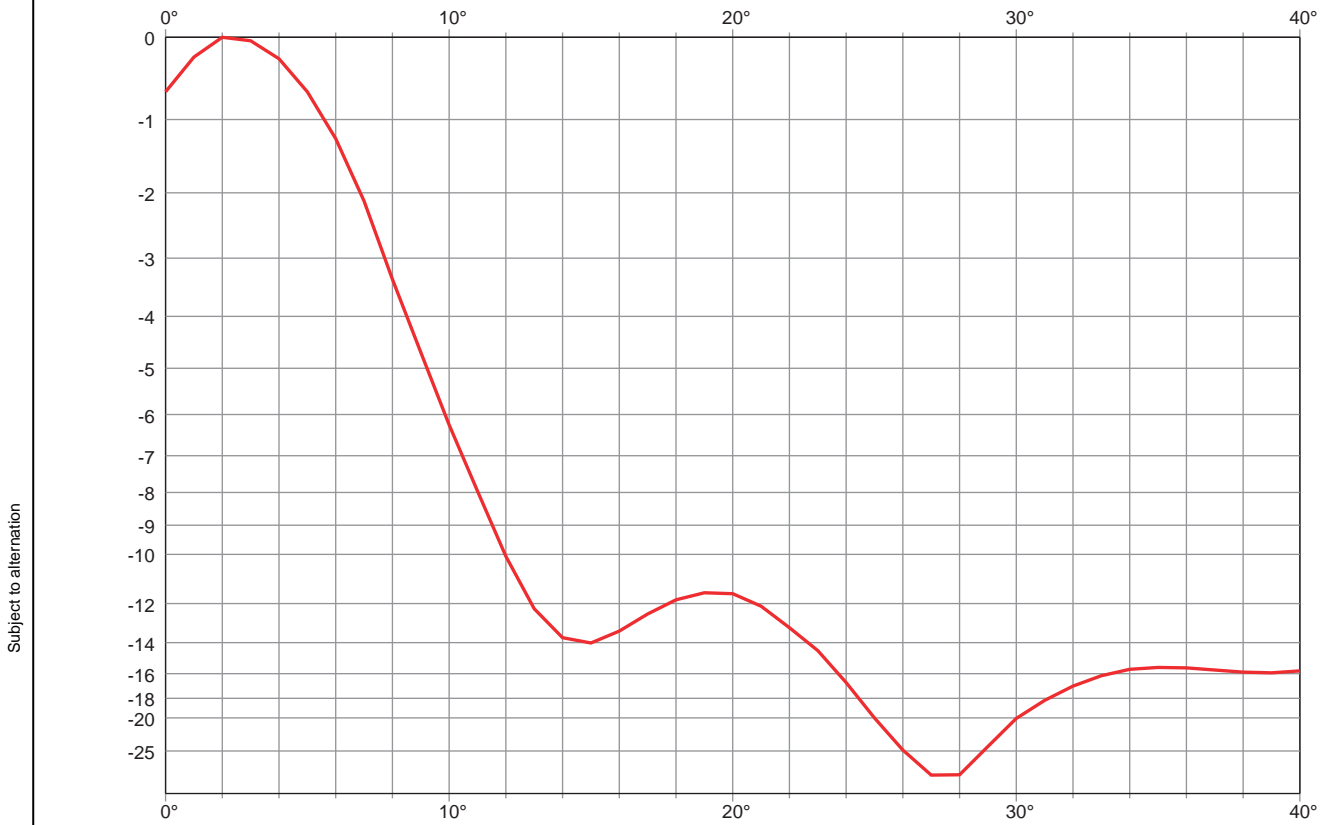

| | |
|-----------------------|---------|
| UHF Cardioid Panel | |
| Frequency | 650 MHz |
| Gain | 10 dBd |
| Half Power Beam Width | 10° |

All Pattern

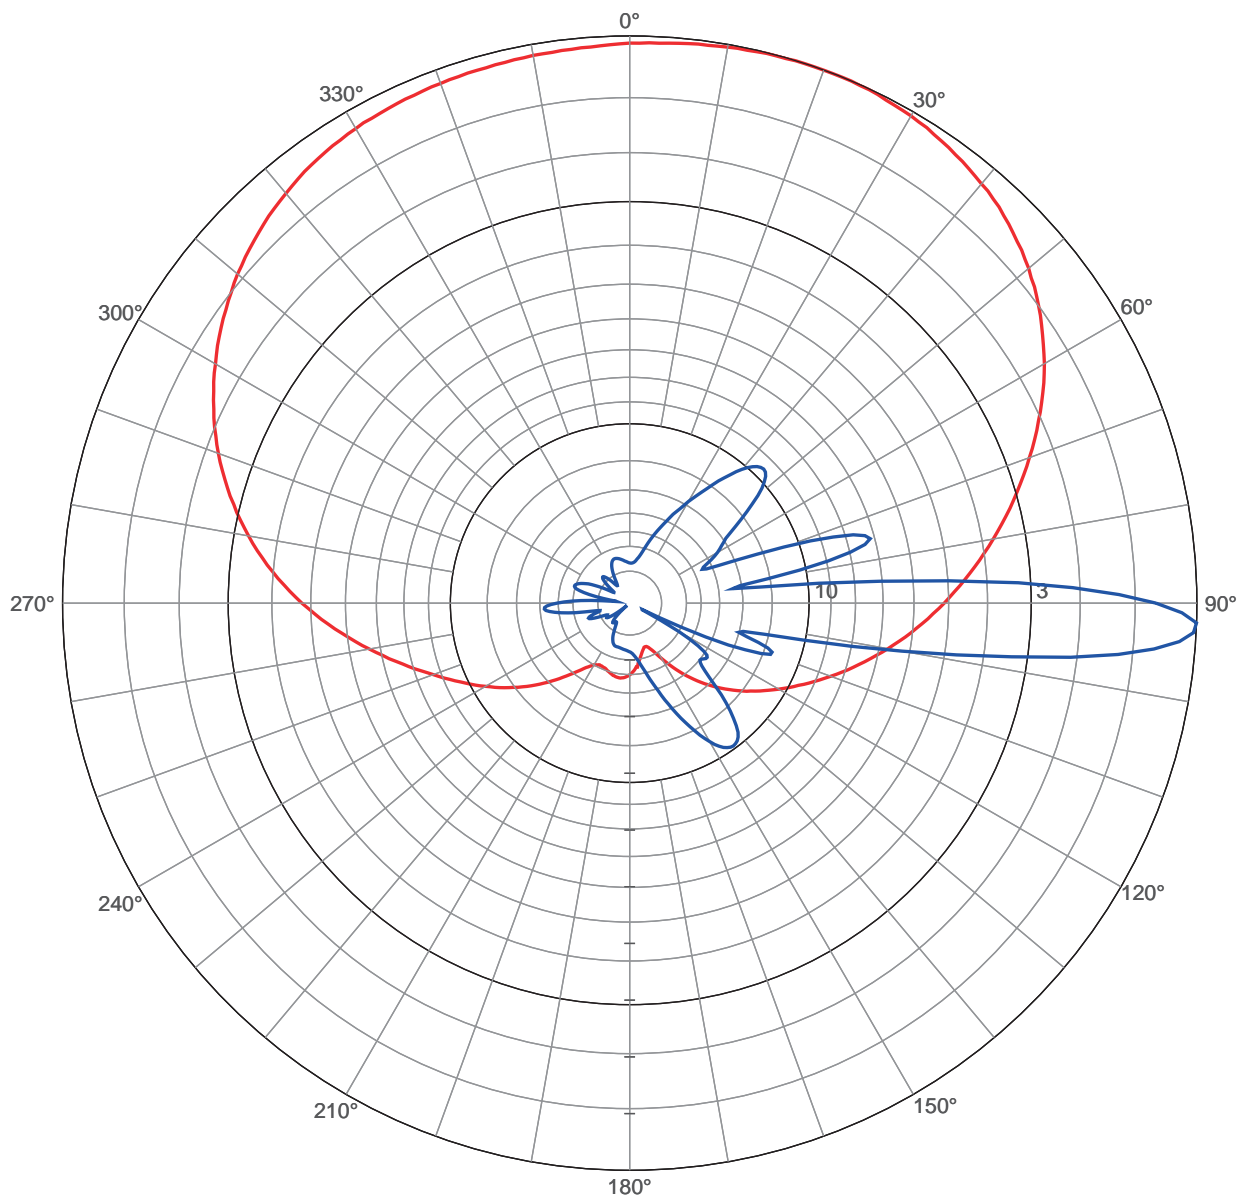

Subject to alternation

UHF Cardioid Panel

Frequency 650 MHz

Gain 10 dBd

Half Power Beam Width 152°/ 10°
